

Marketing Update


 FIRE-LITE® Alarms
by Honeywell

IP Monitoring of ANY Competitive FIRE PANEL

February 27, 2008
Document FLMU08-02-2

Fire-Lite is pleased to announce UL-864 compatibility listing of the 411 and 411UD slave dialers with the IPDACT Internet Alarm Communicator. Customers can now monitor the common alarm, common trouble and supervisory relays of any competitive fire alarm

panel over the Internet or an internal Intranet with the IPDACT and a central station equipped with a compatible Teldat Corporation VISORALARM-PLUS IP receiver.

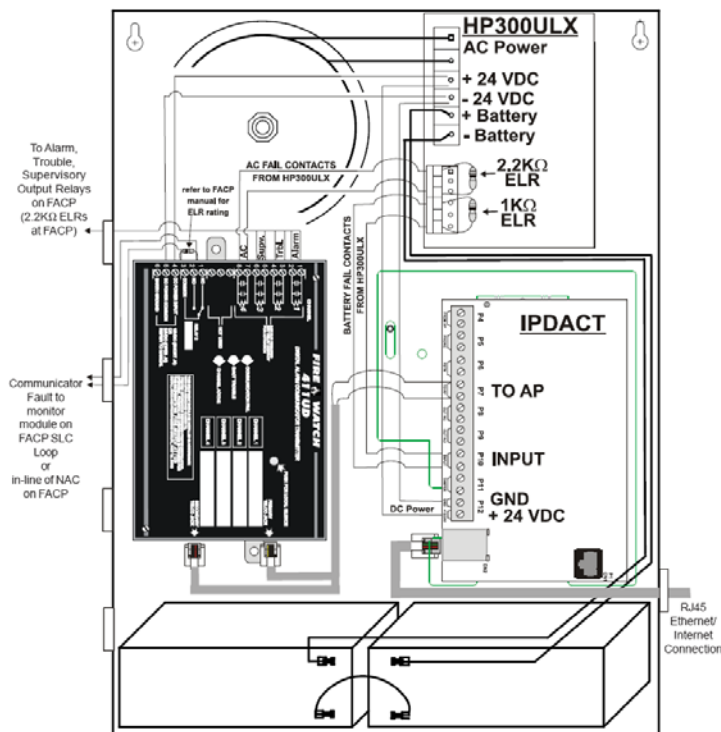


The assembly consists of a 411 or 411UD, IPDACT, IPBRKT and HP300ULX power supply. All components are purchased separately at distribution and mounted inside the HP300ULX as shown in the drawing.

The assembly is listed according to NFPA 72 guidelines found under section 8.5.4 of the 2002 edition and section 8.6.4 of the 2007 edition, "Other Transmission Technologies, Packet Switched Data Network." No redundant connection such as a backup phone line is required thereby saving significant monthly telephone

charges.

For more information, go to www.firelite.com and download Product Installation Document PN: 53109. To obtain pricing and ordering information, please contact our Customer Service Department: [at 1-800-627-3473](tel:1-800-627-3473).

Sincerely,



Nick Martello
Fire-Lite Marketing Director

Document FLMU08-02-2